


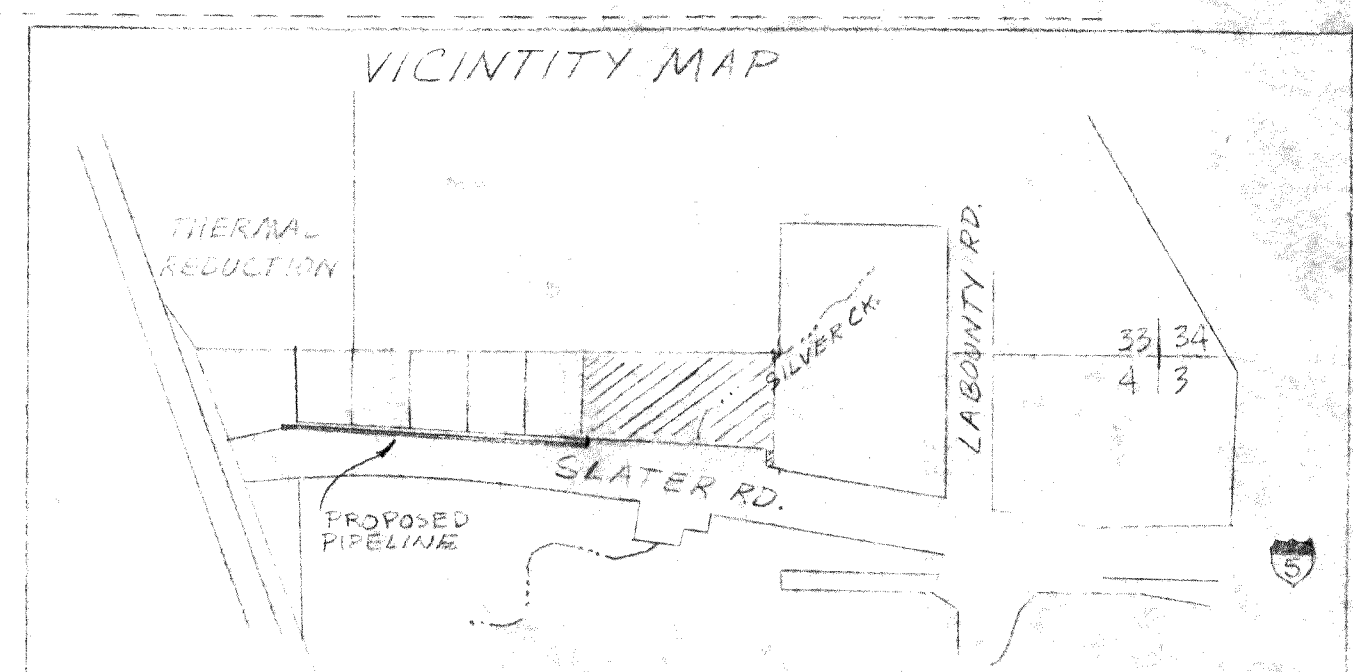

FUTURE SHOP

CALLEN
CONSTRUCTION CO.
INC.

32 33
514
S. 89° 59' 47" W. 2624.79

THERMAL
REDUCTION
CO.

ELDRED &
ESSEX

NORTHWEST

10" TO 6" TEE
6" GATE VALVE
6" HYDRANT


10" TO 6" TEE
6" GATE VALVE
6" HYDRANT

6" HYDRANT
6" GATE VALVE


8" tap
4" gate valve
4" fire hydrant

1- 8x6" TEE
1- 6" GATE VALVE
1- 6" HYDRANT
1- CONC. THRUST BLOCK
2- SHACKLE ROD

1- 12x8" TEE
1- 8" GATE VALVE
1- CAP W/ 12" TAP
1- 2" GATE VALVE
2- CONC. THRUST BLOCK

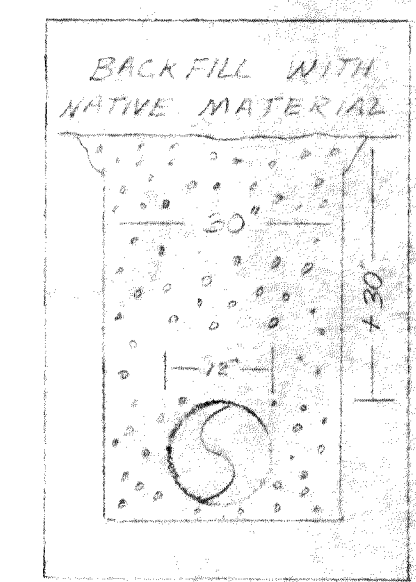

TYPICAL DITCH

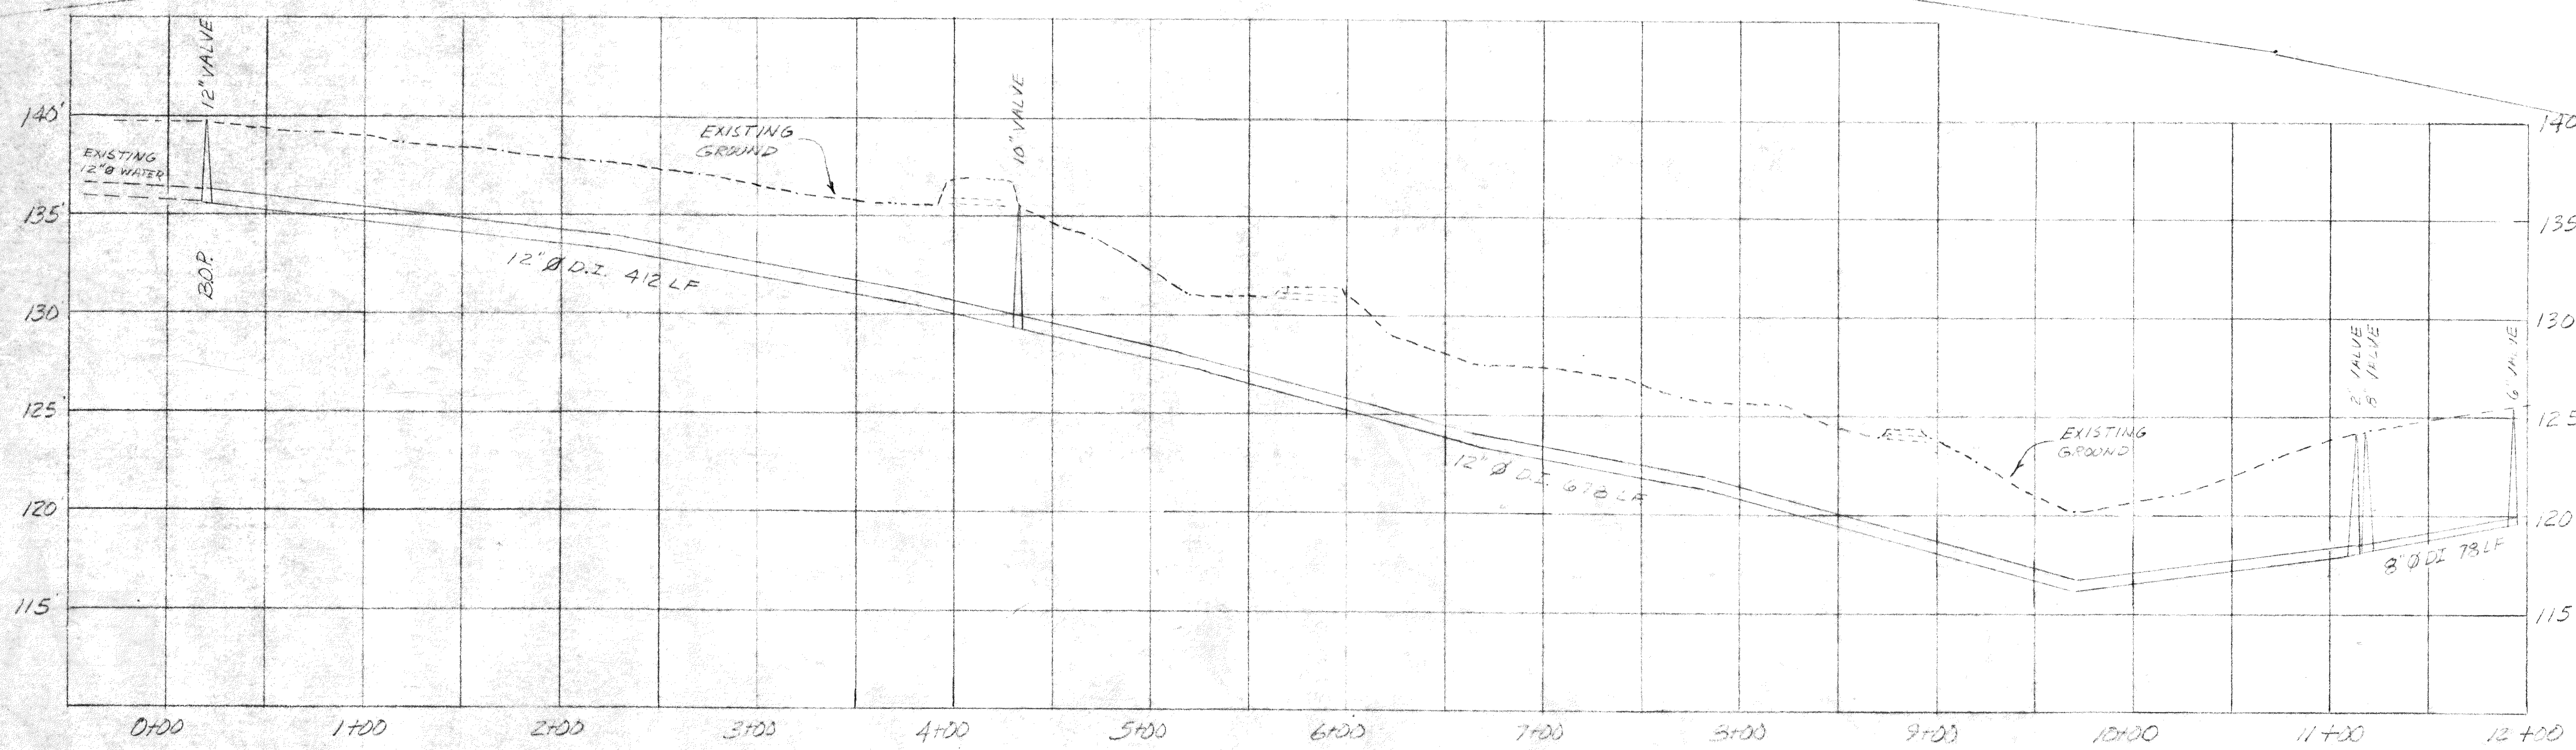

SCALE
HORIZ. — 1"=50'
VERT. — 1"=5'

LEGEND

- W — PROPOSED WATER LINE
- ◀ ▶ VALVE
- ▢ THRUST BLOCK
- FIRE HYDRANT

CALLEN
CONSTRUCTION CO.
CUSTER, WA.
PROPOSED WATER PIPELINE
PLAN

SCALE 1"=50' MARCH 4, 1988